

## XAL - 53 Explosion-Proof Pull Station

### APPLICATIONS

XAL-53 fire alarm stations are suitable for:

- Hazardous areas due to the presence of flammable gases or vapors, combustible dusts or easily ignitable fibers or flyings.
- Installation at petroleum refineries, chemical and petrochemical plants, storage areas, and other processing facilities where hazardous substances are handled and stored.
- Areas where emergency control of fire alarm or signal circuits is required.

### FEATURES

- Enclosure is made of copper-free aluminum alloy.
- Conduit openings are 3/4" (19.05 mm) NPT feed-through.
- Red, textured powder epoxy paint finish is standard on box and cover and provides high visibility for alarm station.
- Universal (1) normally open and (1) normally closed contact furnished standard.
- Bilingual nameplates included per CSA requirement.
- Internal ground screw is standard.
- Wiring range is #12 AWG through #24 AWG, solid or stranded.

### OPERATION

The alarm station is activated by lifting the front cover and pulling down ring. This quick, easy-to-use two-step process prevents unintentional operation. Operator is reset by depressing shaft and returning plate to original position.

### HAZARDOUS AREA CLASSIFICATIONS

- Class I, Division 1 and 2, Group C and D.
- Class II, Division 1 and 2, Group E, F, and G.
- Class III, Hazardous Locations.
- NEMA 7CD, 9EFG.

### CONTACT BLOCK RATING ►

5274acdc.tbl

A C						D C		
Volts	Make Amperes	VA	Break Amperes	VA	Continuous Carrying Amperes	Volts	Make Break	Continuous Carrying Amperes
120	60	7200	6.0	720	10	125	1.10	10
240	30	7200	3.0	720	10	250	0.55	10
480	15	7200	1.5	720	10	600	0.20	10
600	12	7200	1.2	720	10			



**UL LISTED**  
E50498



CE69

**CSA**

LR31085




California State Fire Marshal  
7150-1439:100



5274pho.jpg

**XAL-53**  
Pull Ring

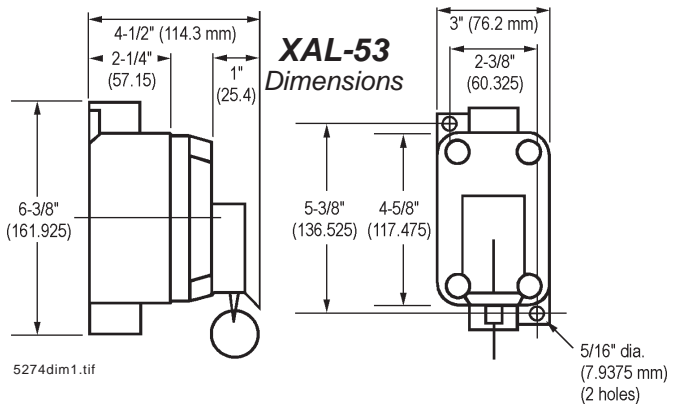

**Gamewell-FCI**  
12 Clintonville Road  
Northford, CT 06472-1610  
Phone: 203-484-7161  
Fax: 203-484-7118  
www.gamewell-fci.com

Specifications and wiring information are provided for information only and are believed to be accurate. Gamewell-FCI assumes no responsibility for their use. Data and design are subject to change without notice. Installation and wiring instructions shipped with the product shall always be used for actual installation.  
**For more information, contact Gamewell-FCI, a Honeywell company.**

## OPERATIONAL DATA

This enclosure is made of cast, copper-free aluminum alloy. It is suitable for: Class I, Groups C and D; Class II, Groups E, F, and G; and Class III hazardous locations. All installations must comply with applicable local and/or National Electrical Code.

### **CAUTION!**

*During installation, DO NOT use looped wire under terminals. Break wire run to provide supervision of connections.*

Like all electromechanical devices, these control stations require occasional maintenance. Parts may wear out or become defective due to adverse environmental conditions. See *Maintenance Data* below.

## MAINTENANCE DATA

### **CAUTION!**

*Disconnect this device from the supplying circuit before removing the cover.*

1) To prevent corrosion, lubricant should be occasionally applied, as follows:

- Killark® "LUBG" lubricant **to box/cover flanges.**
- Dow Corning® Molykote® 33 Grease, light consistency, **to operator shaft.**

2) Keep all flanges clean and free of scratches.

3) Some internal service parts are available. Consult the Killark® factory for parts breakdowns.

KILLARK® is a registered trademark of Hubbell®. Dow Corning® and Molykote® are registered trademarks of Dow Corning Corporation.

## PRODUCT LINE INFORMATION


**XAL-53** Pull station, explosion-proof, N/O and N/C contacts.

**SBA-10** Backbox.

## CONTACT ARRANGEMENT

### **NOT ACTIVATED POSITION** ▶

5274con1.wmf

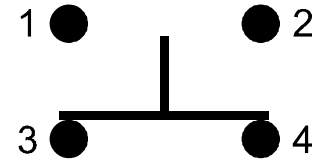

### **ACTIVATED POSITION** ▶

5274con2.wmf

